
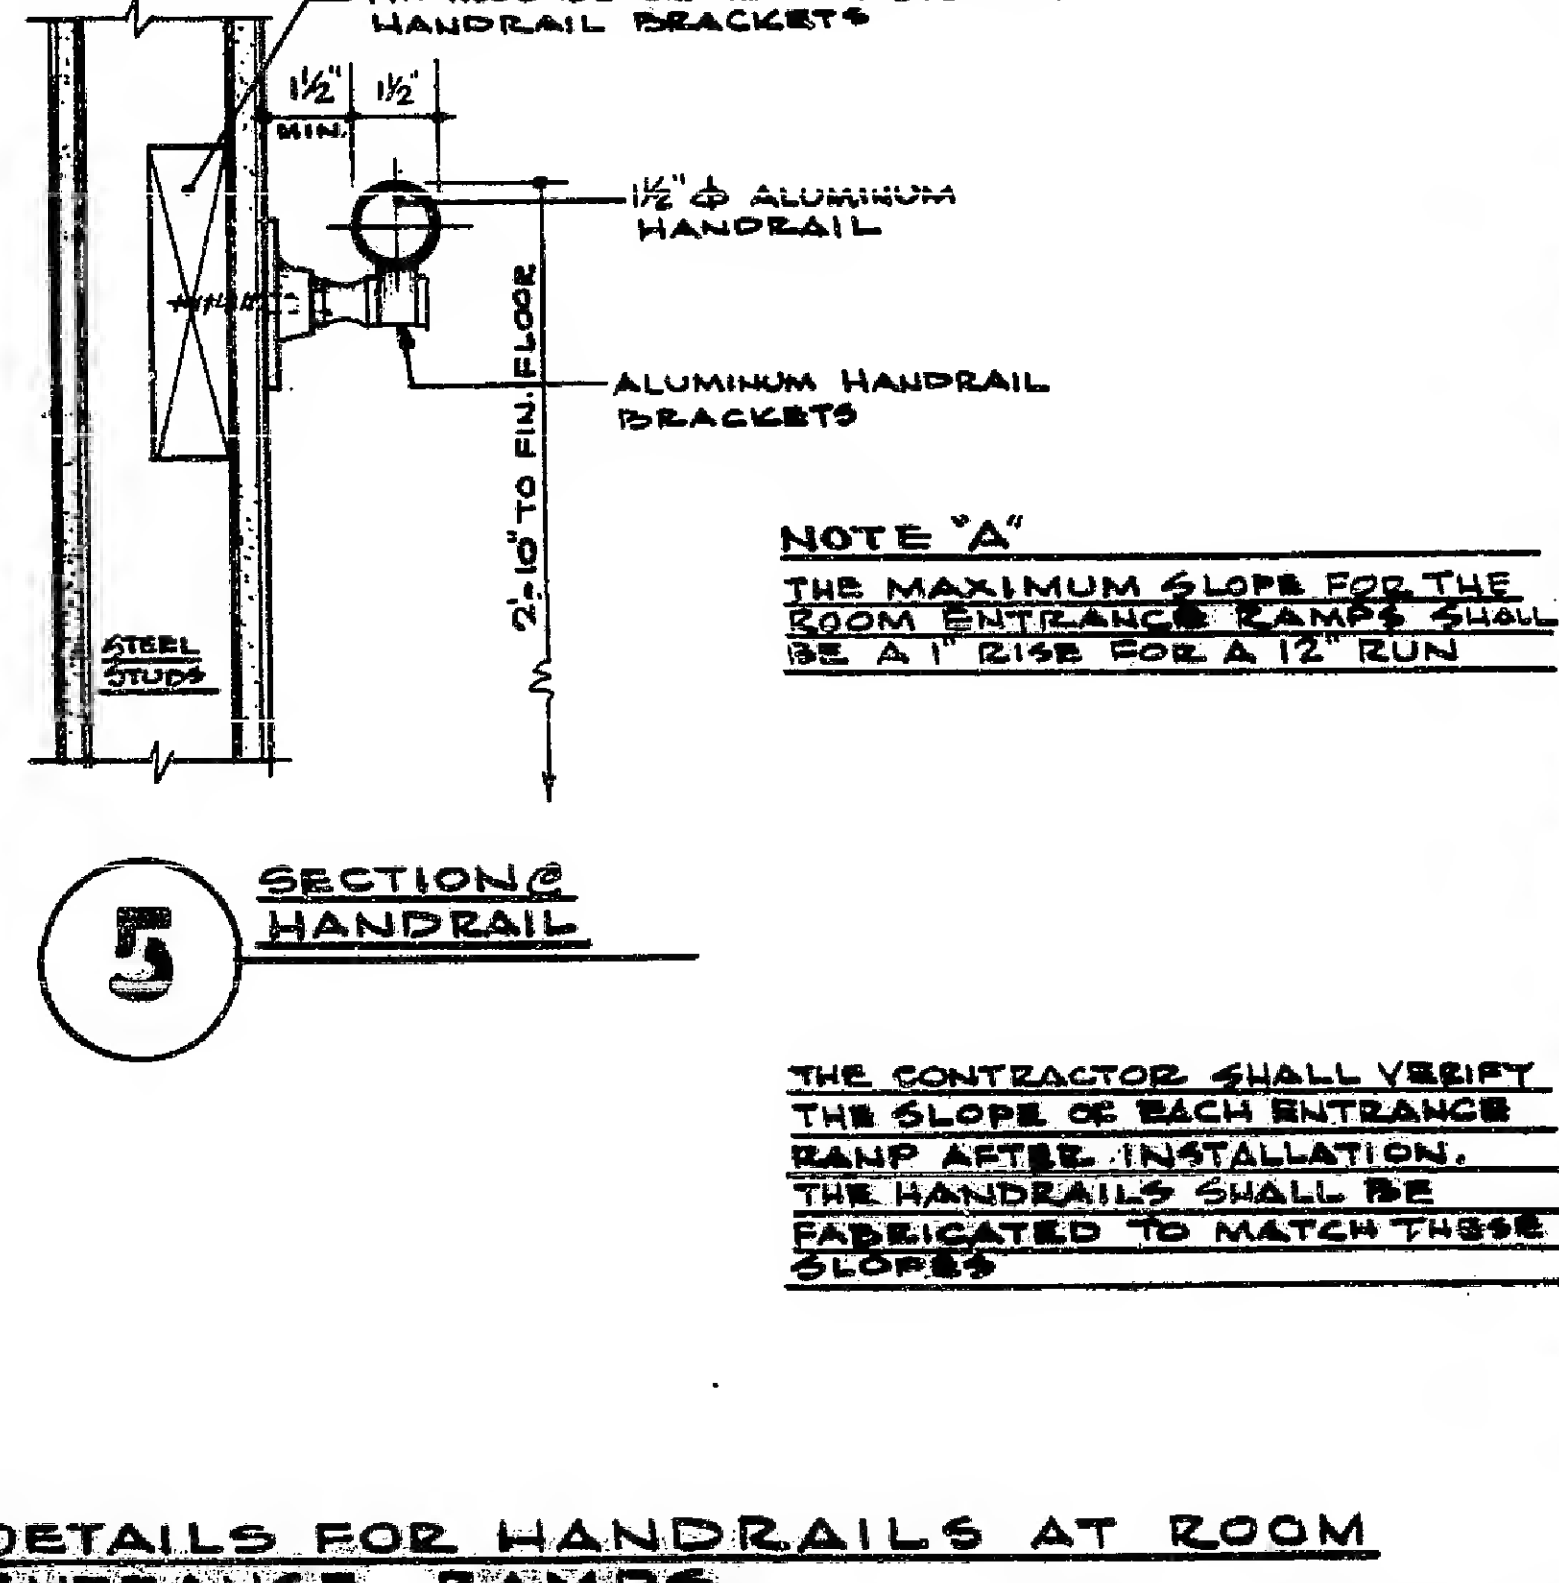
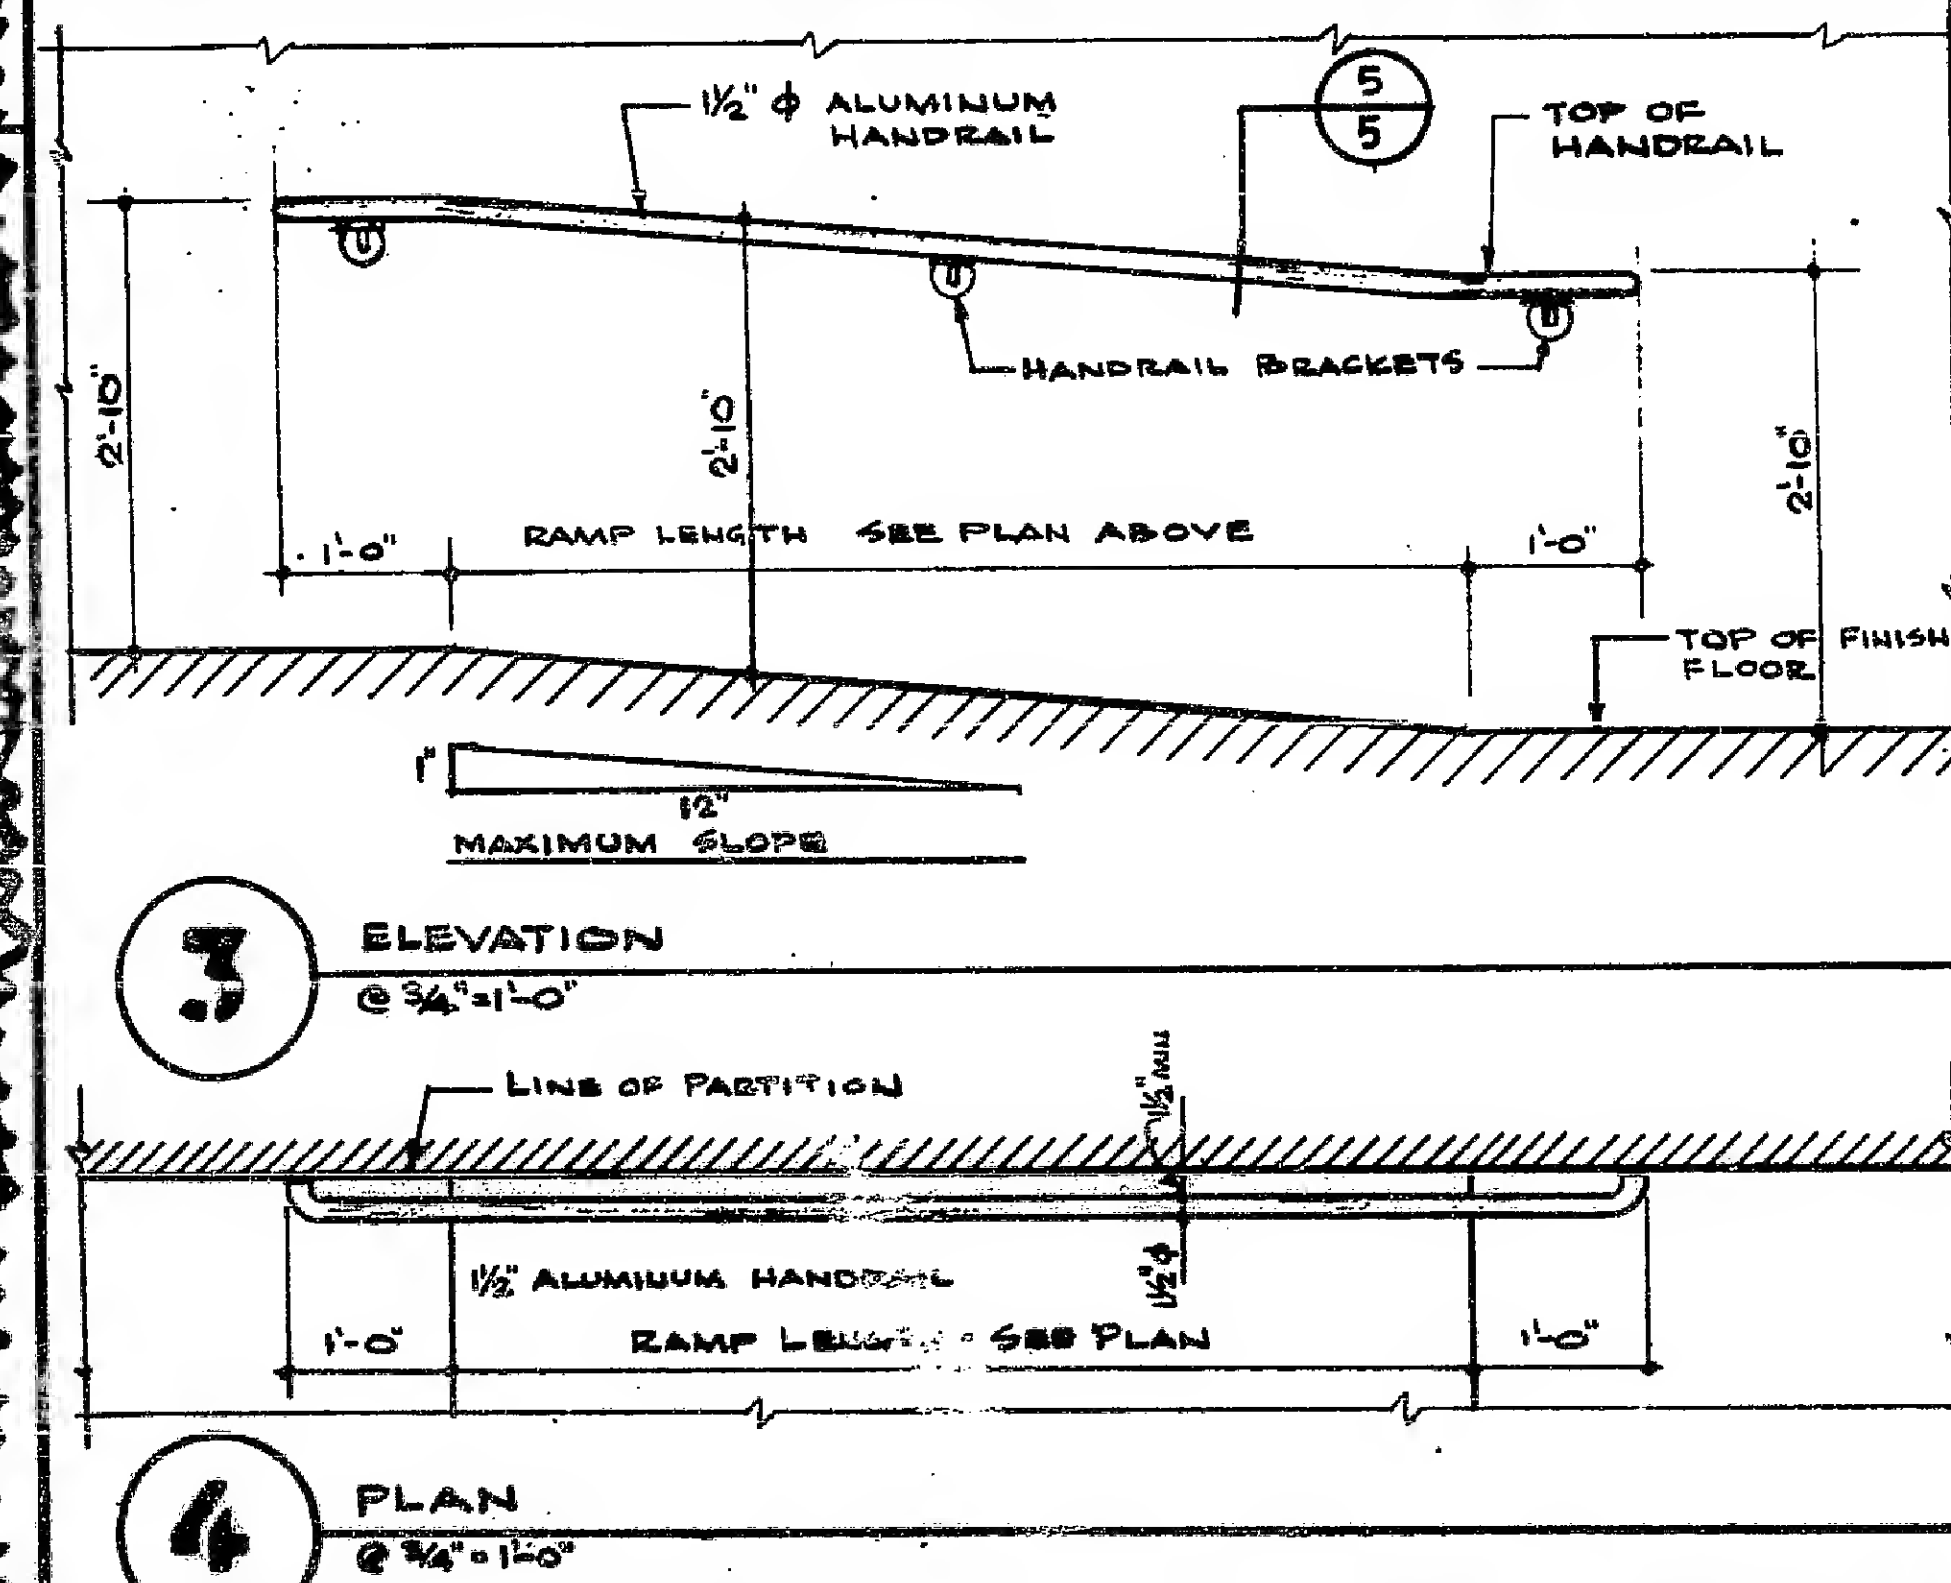
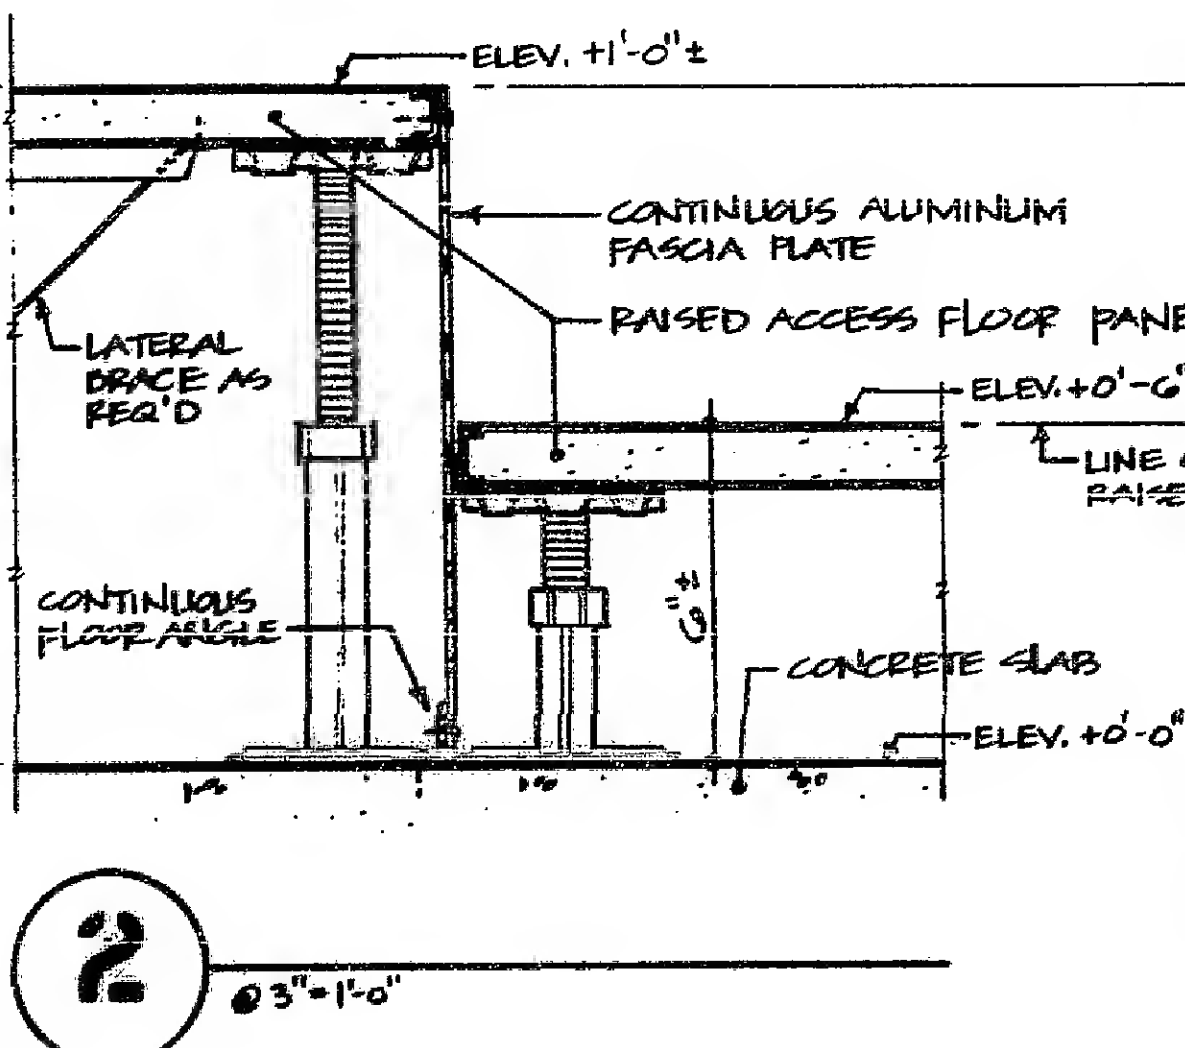


RAISED FLOOR DETAILS

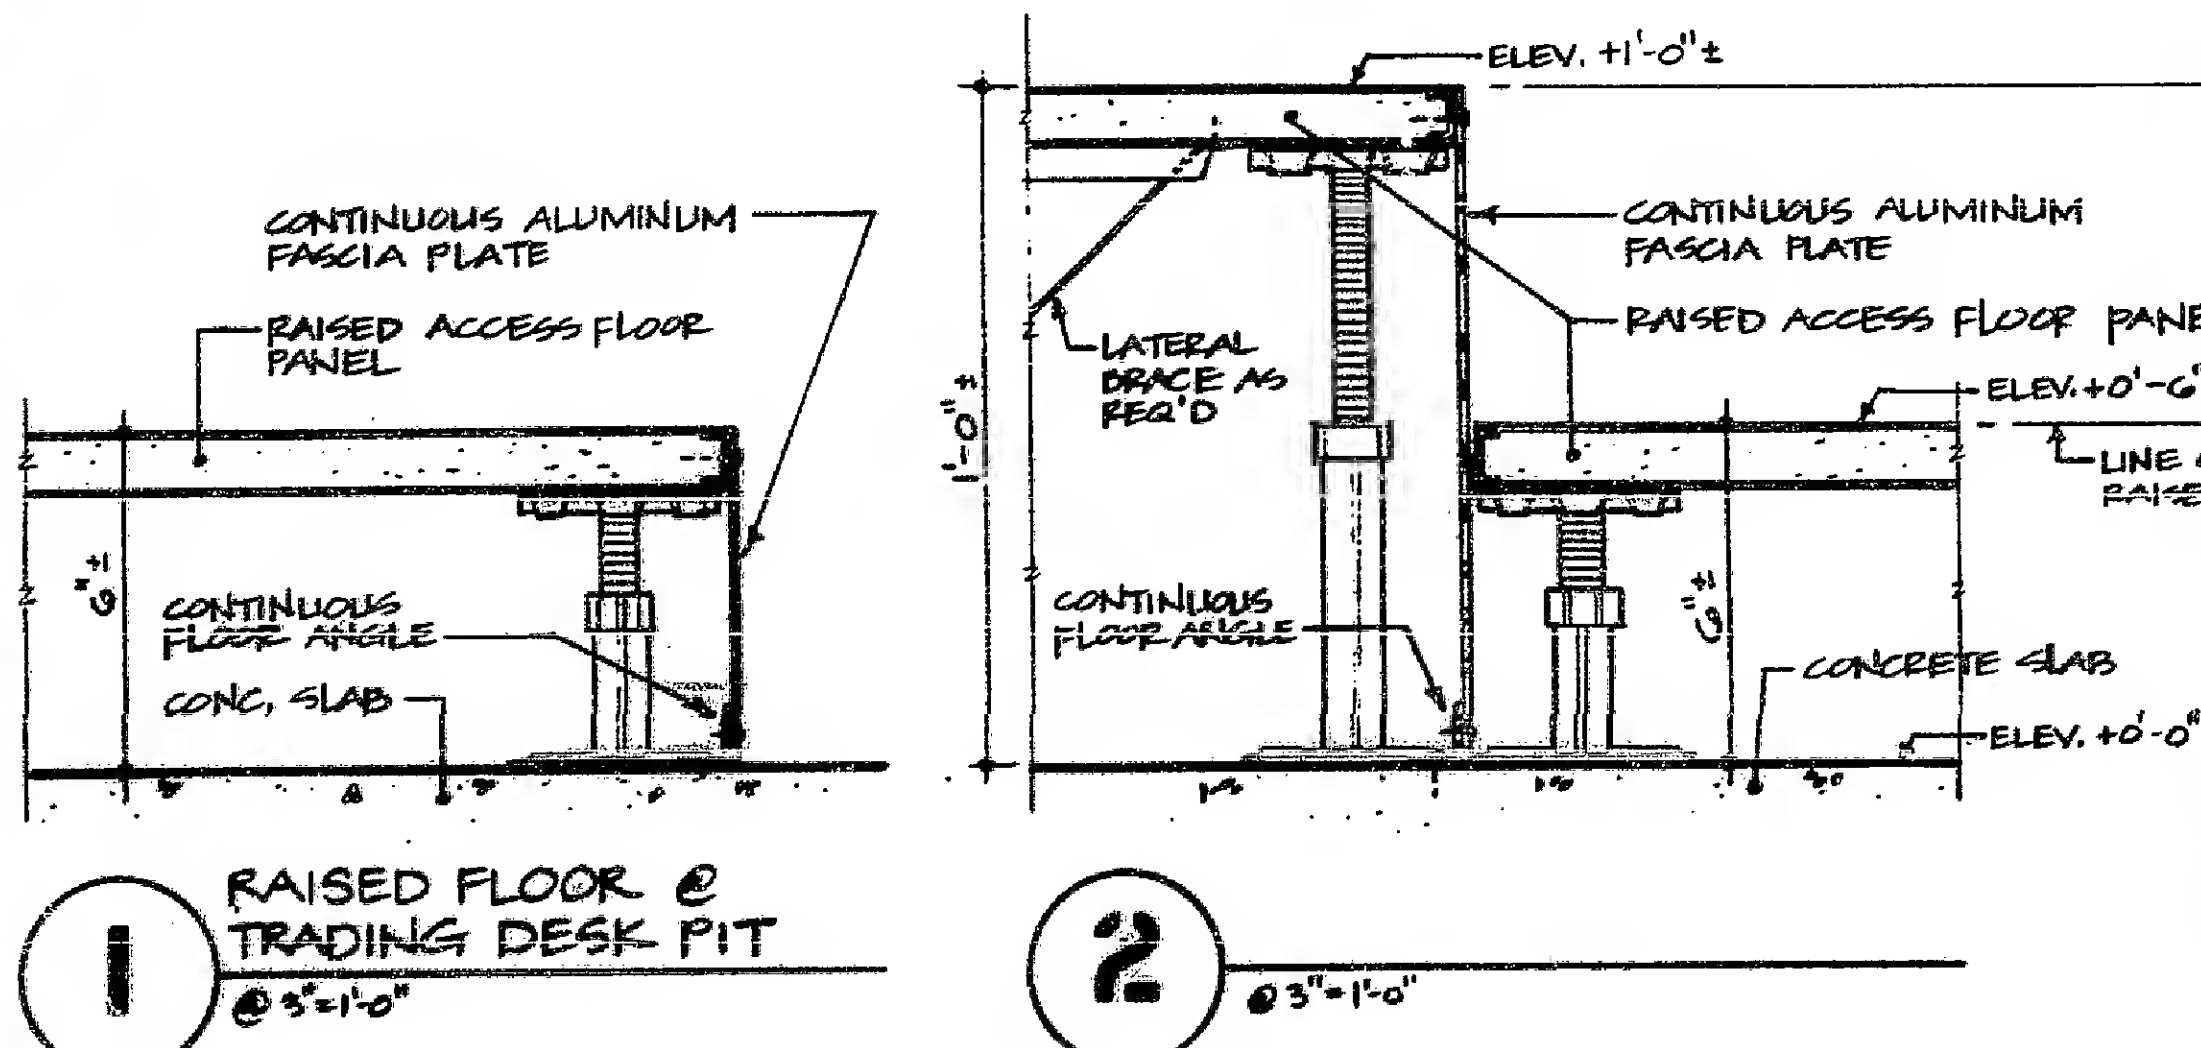

DETAILS FOR HANDRAILS AT ROOM ENTRANCE RAMP

NOTE "A"
THE MAXIMUM SLOPE FOR THE ROOM ENTRANCE RAMP SHALL BE A 12" RISE FOR A 12" RUN.

THE CONTRACTOR SHALL VERIFY THE SLOPE OF EACH ENTRANCE RAMP AFTER INSTALLATION. THE HANDRAILS SHALL BE FABRICATED TO MATCH THESE SLOPES.